


# STORM DRAIN PIPE INSTALLATION BEDDING & BACKFILL REQUIREMENTS

(RIGID PIPE)

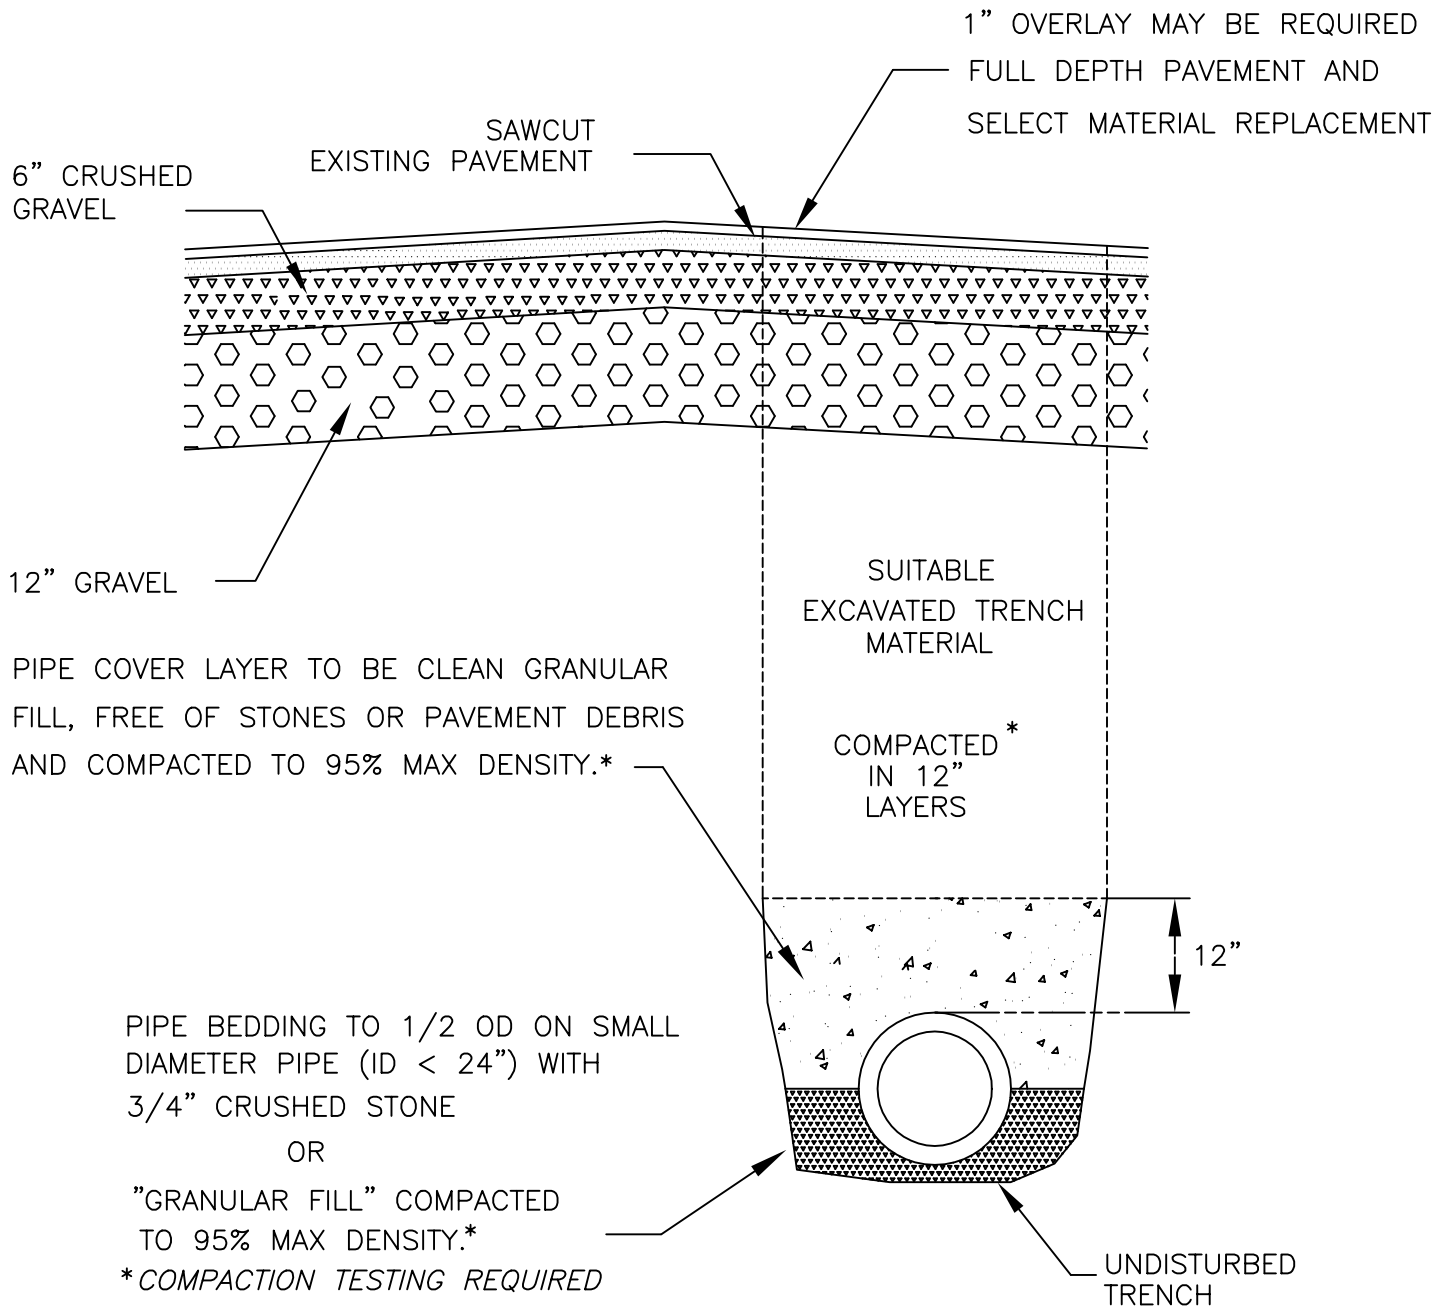

PIPE BEDDING TO 1/2 OD ON SMALL DIAMETER PIPE (ID < 24") WITH 3/4" CRUSHED STONE

OR

"GRANULAR FILL" COMPACTED TO 95% MAX DENSITY.\*

\* COMPACTION TESTING REQUIRED

(AS DEFINED BY AASHTO T180 MODIFIED PROCTOR DENSITY)